



DOROT Control Function Flow Regulation (FR)

Control Function Flow Regulation (FR)

Flow Regulation Using 31-10F Pilot

Applicable Series:

S500, S300, S100

Sizes:

1½" - 6" / 40-150mm

1. Function Description

Dorot Series 300 Flow Control Valve ('30-FR') is activated by the pressure of the pipeline. The valve limits the flow rate in the network to a preset value, regardless of upstream pressure variations. The valve fully opens when the flow rate drops below the set point.

2. Technical Features

- Media: Water; natural, non-aggressive fluids
- Pressure rating: PN16 or PN25 (250psi or 360 psi) per specific valve-model.
- Temp. range:
 - S300: 2 – 80°C (35 - 176°F)
 - S500/S100: 2 – 60°C (35 - 140°F)
- Flow velocity for continuous operation: 0.05 – 5.5 m/sec (0.3 – 18 ft/sec)
Max. flow velocity for intermittent operation: 8 m/sec (26 ft/sec)


Notes:

- In case the designed/actual operating conditions are not suitable for the above defined standard features, please contact Aquestia Applications-Engineering.
- Refer to specific valve model publications for further details.

3. Safety Guidelines

- Injury or damage to the system/surroundings may occur if installation, commissioning, operation or maintenance instructions are not followed correctly, or if applicable codes of practice and regulations are ignored.
- Dorot valves are designed for use in fresh water-systems. Please consult Aquestia Applications-Engineering in case other media is to be used.
- Be sure to depressurize the valve, prior to any disassembly of valve or control-trim parts.
- Electrical works (e.g. connection of solenoid-valves, limit-switches etc.), must be executed by a certified electrician.
- Errors in the layout-design, installation or operation may affect valve performance and may be a risk to the system and operators/users. Please note, the system layout, installation and commissioning of valves is the responsibility of the system designer, installer and/or user.
- In any case of doubt and prior to taking any further action, please contact Aquestia representative for assistance.


DOROT Control Function Flow Regulation (FR)

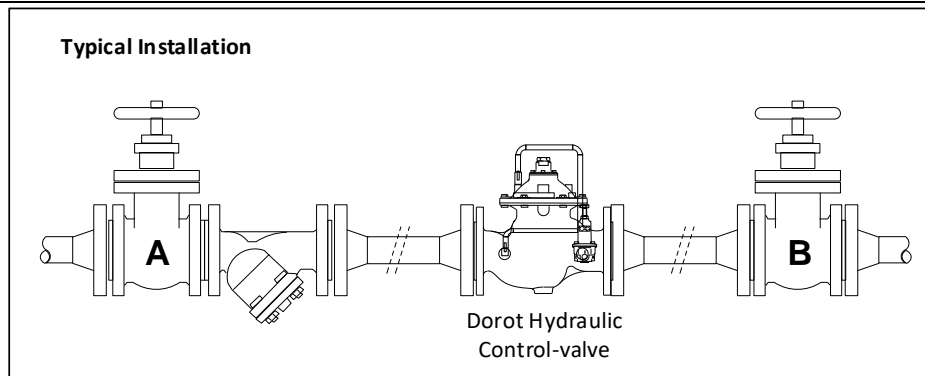

4. Installation

- The valve can be installed in any position, although installation with the bonnet facing up is recommended for ease of maintenance.
- Flow direction should match the engraved arrow on the bonnet.
- For maintenance considerations, it is recommended that manual isolation valves (gate or butterfly) are installed, both sides with a strainer between the upstream isolation valve and the valve inlet (as shown in the diagram above).
- Flush pipeline upstream of the valve, before assembly of the control valve.

5. Control-trim Design

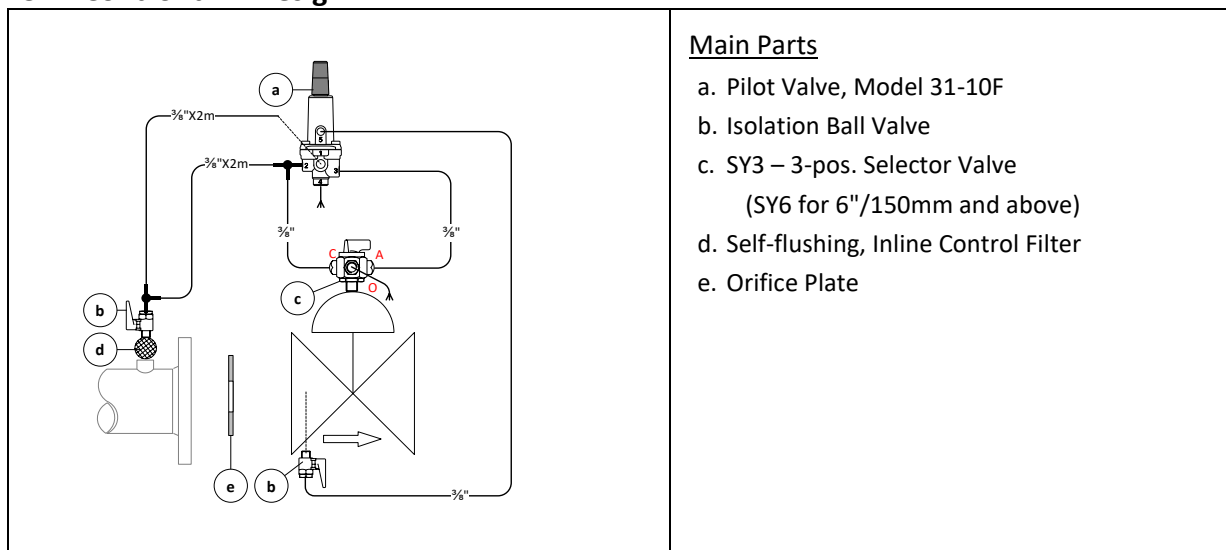

6. Commissioning & Adjustment

- Enable unrestricted flow in the network.
- Open ball valves [b].
- Start the pump or open isolation valve [A].
- Bleed air out of the control chamber (refer to 'Air Bleed Procedure' below).
- Dismantle cover on the pilot valve [a].
- Adjust flow rate limit using the adjustment bolt on the pilot valve [a]. Turn clockwise to increase flow rate and counter-clockwise to decrease flow rate.
- Reassemble the adjustment bolt cover.

ⓘ Charging the downstream system must be done slowly to prevent pressure surges


DOROT Control Function Flow Regulation (FR)

Air bleed in S-300/500 valves

This should be done with the control chamber pressurized (main valve closed)

Using the supplied Allen key – open air-bleed-screw at the top of the bonnet and reclose it when only water, (no air) is discharged (refer to diagram on the right).

In cases where an indicator rod exists – using hand force only – release and tighten the round nut at the top of the indicator guide.

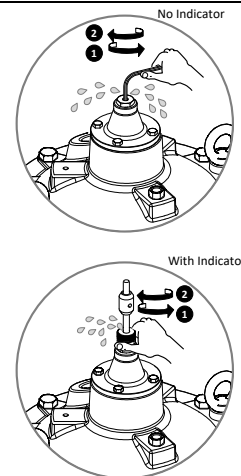


7. Manual Activation

① Note that


The valve can be opened or closed manually by operating the selector valve.

Turn the handle toward port “OPEN” or “CLOSE” respectively.



8. Maintenance

- Inspect and clean the inline filter [c] as water quality dictates. This service should be performed every few months.
- During this operation, the main valve must be isolated from external pressure, by closure of up- and downstream isolation valves [A, B].
- Inspect valve performance by checking water levels periodically.

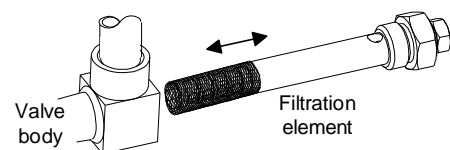

Extraction of screen element, filter


DOROT Control Function Flow Regulation (FR)

9. Troubleshooting		
General check list	Ball valves [b]	All must be open when operated
	Schematic diagram	Verify that the piping is consistent with the schematic diagram
		Verify that the orifice is the correct diameter
	Release air trapped in the control chamber	
	Filter	Check and clean
	System adjustment	Verify that the pilot valve is adjusted correctly
	Needle valve	Fully close the needle valve and reopen it, 1.5 turns
Low downstream flow	Downstream pressure is too low even though the valve is open	Verify consumption can be supplied with the selected valve size
	Manual isolation valves [A] or [B] are throttled/closed	Verify all isolation valves upstream of the pressure gauge are fully open
	Adjustment bolt on pilot valve [a] is open	Readjust (see section 2)
High downstream flow	Downstream pressure is too high	Verify there is no other pressure source in the zone
	Filter [f] and/or needle valve [c] and/or nozzle [d] are clogged	Check and clean
	Adjustment bolt on pilot valve [a] is too tight	Readjust (see section 2)
	Foreign object stuck in the main valve's internal-trim	Disassemble main valve, extract inner trim and flush/remove foreign object
	Main valve diaphragm is cracked	Disassemble and replace diaphragm
	Cracked pilot valve diaphragm (water flow from pilot valve bonnet) or defective internal seal	Replace the pilot valve diaphragm assembly

Aquestia Ltd. reserves the right to make product changes without prior notice. To ensure receiving updated information on parts specifications, please contact us at info@aquestia.com.
Aquestia Ltd. shall not be held liable for any errors. All rights reserved.